


20 lb ROOF LOAD SIDEWALL OPENING PIER LOAD 14' BOX WIDTH	SIDEWALL OPENING (FT)					
	3	4	5	6	8	10
	1175	1330	1485	1640	1950	2260

*FOR 30 lb & 40 lb ROOF LOAD REFER TO TABLES 7 & 7a IN THE INSTALLATION MANUAL.

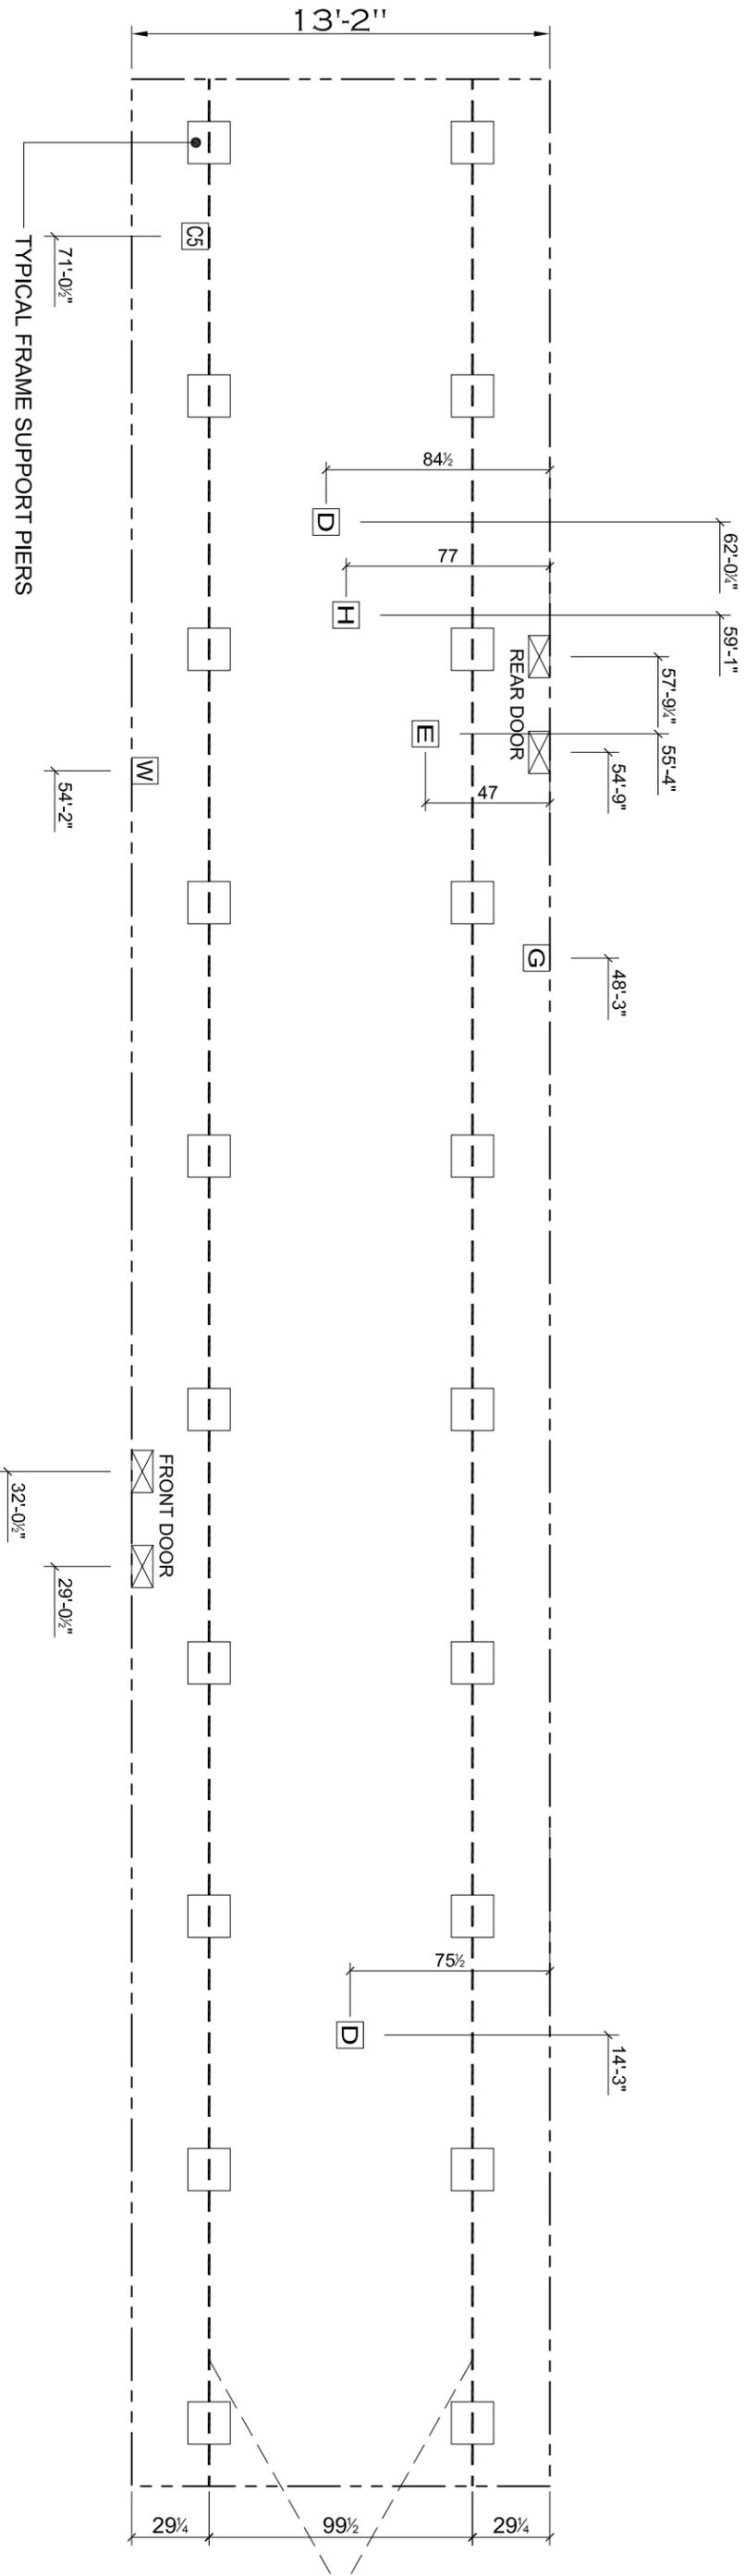

PIER LEGEND	
<input type="checkbox"/>	= PIER MAIN BEAM
<input checked="" type="checkbox"/>	= PIER PERIMETER
<input checked="" type="checkbox"/>	= PIER PORCH/RECESSED ENTRY

SERVICE DROP LEGEND	
E	= ELECTRICAL DROP
W	= WATER INLET
D	= DWV PLUMBING DROP
G	= GAS INLET
H	= HVAC DROP
CS	= COMMUNICATIONS DROP
EX	= ELECTRICAL CROSSOVER
WX	= WATER CROSSOVER
HX	= HVAC CROSSOVER

NOTES:

- REFER TO TABLES 6 AND 6a IN THE INSTALLATION MANUAL FOR LOAD ON FRAME PIER FOOTINGS FOR HOMES THAT DO NOT REQUIRE PERIMETER BLOCKING. REFER TO TABLES 7 AND 7a IN THE INSTALLATION MANUAL FOR LOAD ON FRAME PIER FOOTINGS FOR HOMES THAT REQUIRE PERIMETER BLOCKING. REFER TO TABLES 10 AND 10a TO DETERMINE FOOTING SIZE FOR ALL PIERS.
- REFER TO TABLE 9 FOR PIER CONFIGURATION AND MAXIMUM ALLOWABLE HEIGHTS. CROSS REFERENCE THE PIER HEIGHT WITH THE MAXIMUM ALLOWABLE FLOOR HEIGHT LISTED IN THE FRAME TIEDOWN CHARTS (TABLE 18, 19, AND 20).
- THE MAXIMUM SPACING FOR FRAME SUPPORT PIERS FOR 8" I-BEAMS IS 8 FEET, 10" & 12" I-BEAMS IS 10 FEET.
- SERVICE DROP LOCATIONS IDENTIFIED ARE APPROXIMATE.
- FLOOR WIDTH SHOWN IS FOR STANDARD PRODUCT ONLY. CONTACT THE MFG FACILITY FOR SPECIFICATIONS OF OPTIONS ORDERED.

REVISION	DATE



MODEL NAME Magnolia	
MODEL NO. TRT14763M	
BOX SIZE 14' X 76'	MODEL SQ. FT. 1000
DRAWN BY DUSTIN HARVILLE	
DATE DRAWN 1/30/2025	
DATE PRINTED 1/11/18/2025	
SCALE 3/16"=1'	
PLAN NO. TRU-1476-32-1	
SHEET NAME PIERS	
SHEET NO. SU-1.	